

Addition of the logo of CC-Link IE Field Network Basic**■Date of Issue**

October 2016 (Ver. A: August 2018)

■Relevant Models

MELSEC iQ-R series, MELSEC iQ-F series, MELSEC-Q series, MELSEC-L series

Thank you for your continued support of Mitsubishi Electric programmable controllers.

We will inform you of the addition of the CC-Link IE Field Network Basic logo.

There is no impact on the general specifications, performance specifications, functions, and external dimensions of modules due to the change.

1 Reason for the change

A new function that supports CC-Link IE Field Network Basic is added to some CPU modules.

2 Changeover period

The logo will be added for the products manufactured on and after November 2016.

For the changeover period for relevant products, refer to the following.

 [Page 2 Details on the change](#)

Note that, depending on stock status, both the old and new products may be distributed in the market around that time.

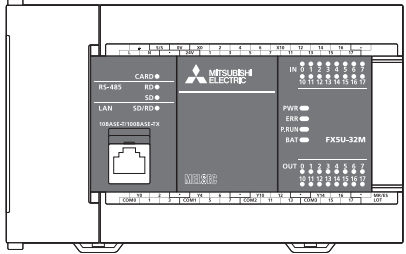
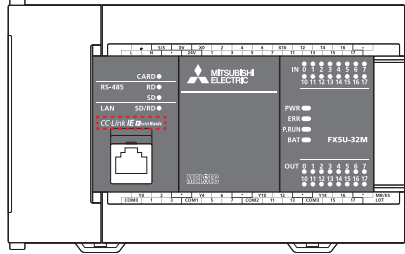
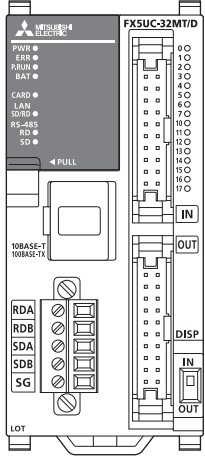
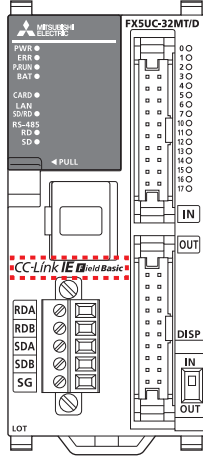
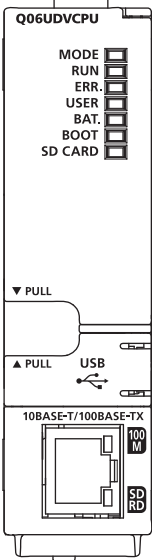
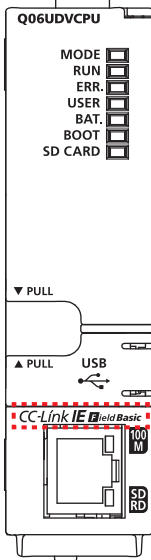
3 Details on the change

For the CPU modules supporting CC-Link IE Field Network Basic, the logo of 10BASE-T/100BASE-TX is replaced with the logo of CC-Link IE Field Network Basic. Note that the Ethernet function still can be used for these modules even without the 10BASE-T/100BASE-TX logo on them.

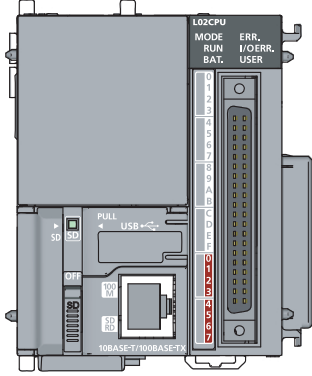
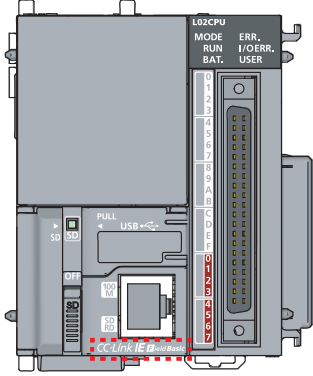
The following table shows details on the logo change.

Relevant model	Before change	After change	Changeover period
R04CPU R08CPU R16CPU R32CPU R120CPU			November 2016
R04ENCPU R08ENCPU R16ENCPU R32ENCPU R120ENCPU			November 2016

FA-A-0219-A

Relevant model	Before change	After change	Changeover period
FX5U-32MR/ES FX5U-32MT/ES FX5U-32MT/ESS FX5U-32MR/DS FX5U-32MT/DS FX5U-32MT/DSS FX5U-64MR/ES FX5U-64MT/ES FX5U-64MT/ESS FX5U-64MR/DS FX5U-64MT/DS FX5U-64MT/DSS FX5U-80MR/ES FX5U-80MT/ES FX5U-80MT/ESS FX5U-80MR/DS FX5U-80MT/DS FX5U-80MT/DSS	 <p>Diagram showing the front panel of an FX5U-32M controller. It features a central display area with 'MITSUBISHI ELECTRIC' branding and 'FX5U-32M' model identification. On the left, there are ports for RS-485, LAN, and SD. On the right, there are status LEDs for PWR, ERR, P.RUN, and BAT. A '10BASE-T/100BASE-TX' port is located at the bottom left.</p>	 <p>Diagram showing the front panel of an FX5U-32M controller after a change. The layout is identical to the 'Before change' diagram, but a red dashed box highlights the 'CC-Link IE Field Basic' logo on the left side of the panel, indicating the addition of this communication protocol.</p>	November 2016
FX5UC-32MT/D FX5UC-32MT/DSS FX5UC-64MT/D FX5UC-64MT/DSS FX5UC-96MT/D FX5UC-96MT/DSS	 <p>Diagram showing the front panel of an FX5UC-32MT/D controller. It includes status LEDs for PWR, ERR, P.RUN, and BAT. On the left, there are ports for RS-485, LAN, and SD. A '10BASE-T/100BASE-TX' port is at the bottom left. The right side features a vertical terminal block with IN and OUT connections, and a 'DISP' port.</p>	 <p>Diagram showing the front panel of an FX5UC-32MT/D controller after a change. The layout is identical to the 'Before change' diagram, but a red dashed box highlights the 'CC-Link IE Field Basic' logo on the left side of the panel.</p>	November 2016
Q03UDVCPU Q04UDVCPU Q06UDVCPU Q13UDVCPU Q26UDVCPU	 <p>Diagram showing the front panel of a Q06UDVCPU controller. It features a vertical row of status LEDs labeled MODE, RUN, ERR, USER, BAT, BOOT, and SD CARD. Below the LEDs is a 'PULL' button and a USB port. At the bottom, there is a '10BASE-T/100BASE-TX' port and an SD card slot.</p>	 <p>Diagram showing the front panel of a Q06UDVCPU controller after a change. The layout is identical to the 'Before change' diagram, but a red dashed box highlights the 'CC-Link IE Field Basic' logo on the left side of the panel.</p>	November 2016

FA-A-0219-A

Relevant model	Before change	After change	Changeover period
L02CPU L02CPU-SET L02CPU-P L02CPU-P-SET L06CPU L06CPU-SET L06CPU-P L06CPU-P-SET L26CPU L26CPU-SET L26CPU-P L26CPU-P-SET L26CPU-BT L26CPU-BT-SET L26CPU-PBT L26CPU-PBT-SET			November 2016

REVISIONS

Version	Date of Issue	Revision
-	October 2016	First edition
A	August 2018	Available for e-Manual Viewer